

HUNTER WATER LABORATORIES

A CONSULTING DIVISION OF HUNTER WATER AUSTRALIA PTY LIMITED
ACN 080 869 905

23 Rosegum Close
WARABROOK NSW 2304
Tele: (02) 4935 0500
Fax: (02) 4935 0505

PO Box 317
Hunter Regional Mail Centre
NSW 2310



REPORT OF ANALYSIS

CUSTOMER: Delta Water Solutions
P.O. Box 507 HRMC NSW 2310

CONTACT: Alex Panov

SAMPLE DATE: 2 August 2010

DATE RECEIVED: 2 August 2010
1 sample, sampled and submitted by customer

REPORT NO.: HWA – 2418/10



Alex

Please refer to attached scan for sample from 'Stewart Broke Water'.

Should you have any enquiries regarding these results, please contact Neil Martin on (02) 4935 0508.

Neil Martin
Chemistry Team Leader
9 August, 2010

*The results on this report relate only to the items tested.
Results from this report are not to be reproduced without acknowledgment.
This document must not be reproduced except in full.*

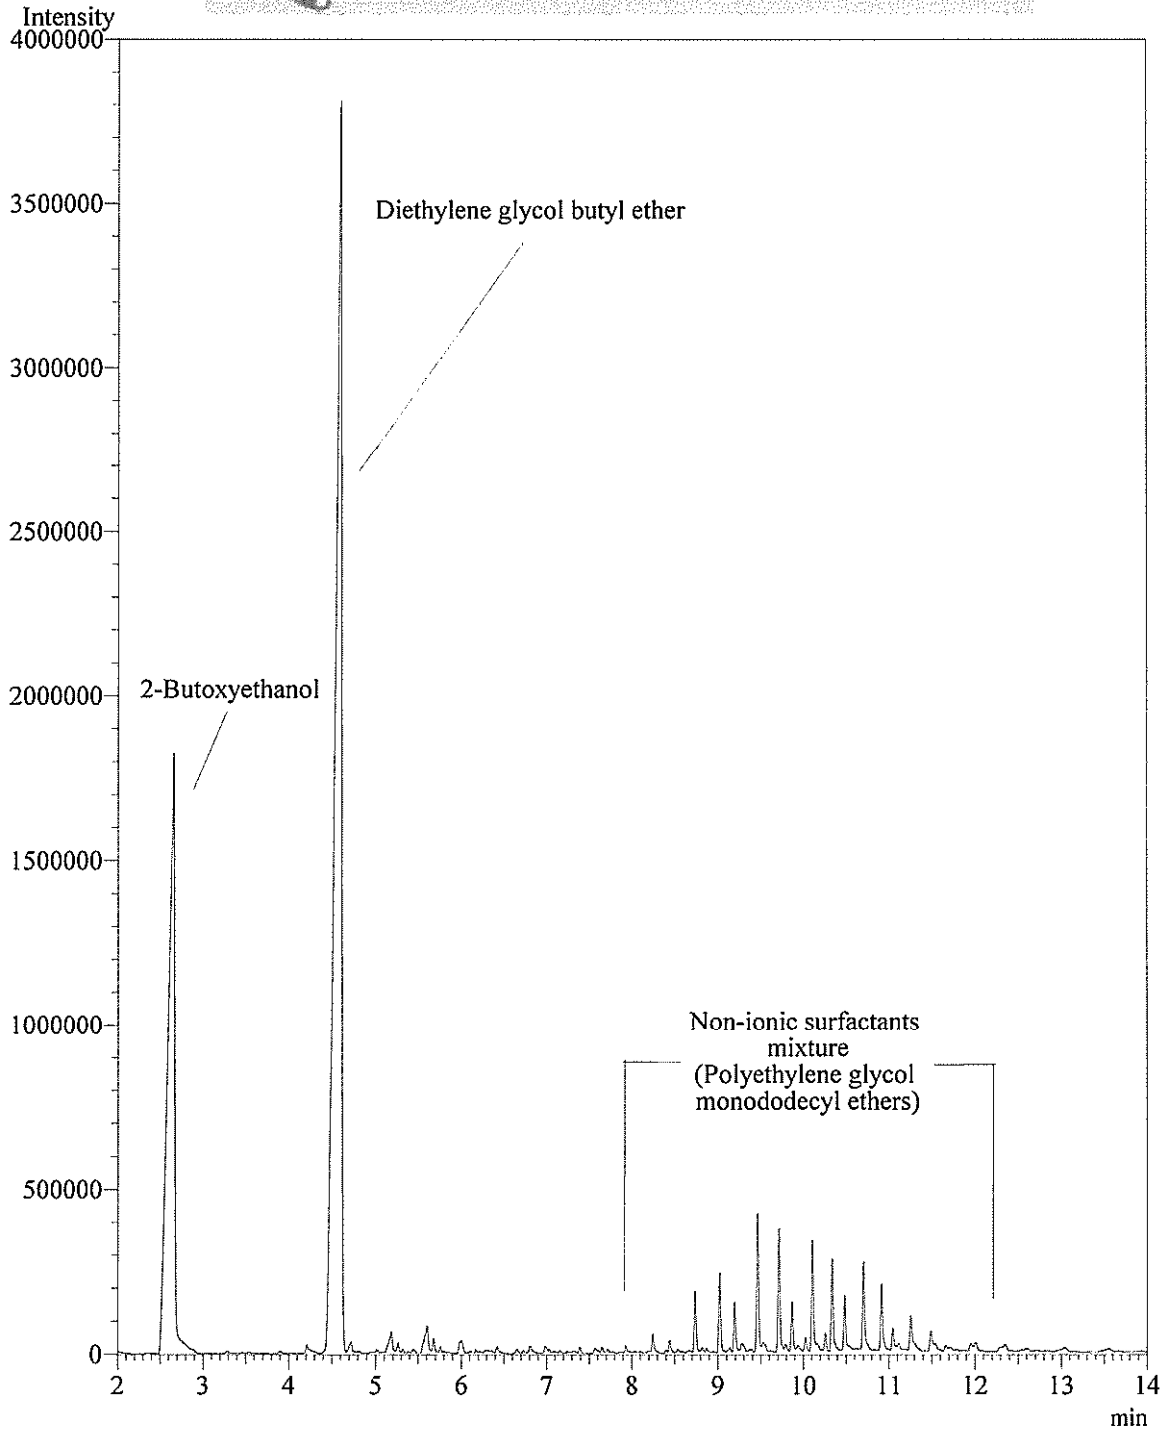

Sample Name : H1018815
Sample ID : Stewart Broke Water
Analysis Date : 06 Aug 2010

*The results on this report relate only to the items tested.
Results from this report are not to be reproduced without acknowledgment.
This document must not be reproduced except in full.*